

Cable Innovations

4737 Hwy 332 Suite 21
Hoschton, GA 30548
800-952-5146



Technical Note

DWG# 11069802 REV B

Subject: What is a JOULE?

One of the values shown on a surge suppressor device specification sheet is the energy specification. The unit of measurement for energy is a joule. The terms power and energy have been used somewhat synonymously. Actually, these two terms do not mean the same thing but are sometime used interchangeably. Power is the ability to do work and is measured in watts. Energy is usually computed by multiplying the amount of power by the length of time the power is used. One watt of power working for one second is known as a wattsecond, or as a joule of energy.


If a 100 watt lamp is turned on for one second, it uses 100 joules of energy. During the time it is working, it is dissipating 100 watts of power. Time is a very important part of this specification. If time is not given, the specification has no meaning. Additionally, if you are comparing joule specifications, you must use the same time frame.

Most of the specifications are based on standard transient waveforms that have been developed to simulate or represent the transient overvoltage environment. These transient suppression standards were developed to serve three needs:

- 1) They are a useful "guide" to designers.
- 2) They give transient component manufacturing standards to which their components can be characterized and specified.
- 3) They give standards for compliance testing.

These standard transient waveforms are stated as 8 X 20 microseconds, 10 X 1000 microseconds, etc on the specification sheets. IEEE has many standards with difference waveforms. Furthermore, the UL will test products using these standards.

The following figure is an example of a standard transient waveform.

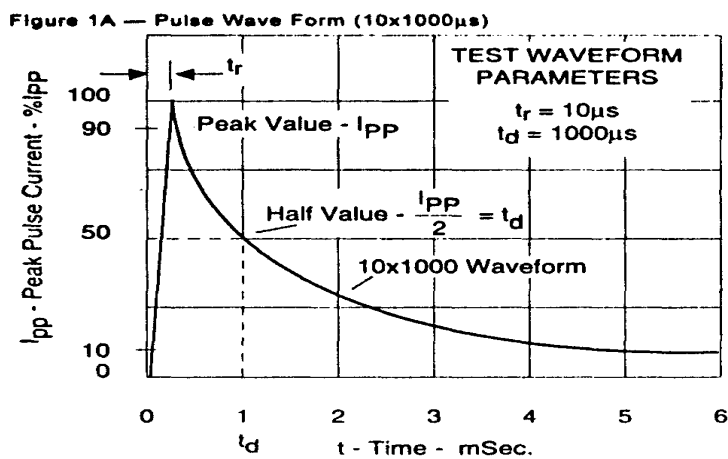

For questions or comments please contact:
Cable Innovations Engineering Dept.
800-952-5146